


Larger rocket using HTP - Clear up after Catastrophic Fuel Spill - Option 2 - Sump pumped to channel drain. - Liquid Storage Tank full - HTP at less than 3% - HTP allowed to degrade to level acceptable to SEPA allowing discharge to soak away over period of time.



Rev 1 - 11/01/22 Title amended
 Rev 0 - 12/10/21 First Issue

fraser ARCHITECTURE

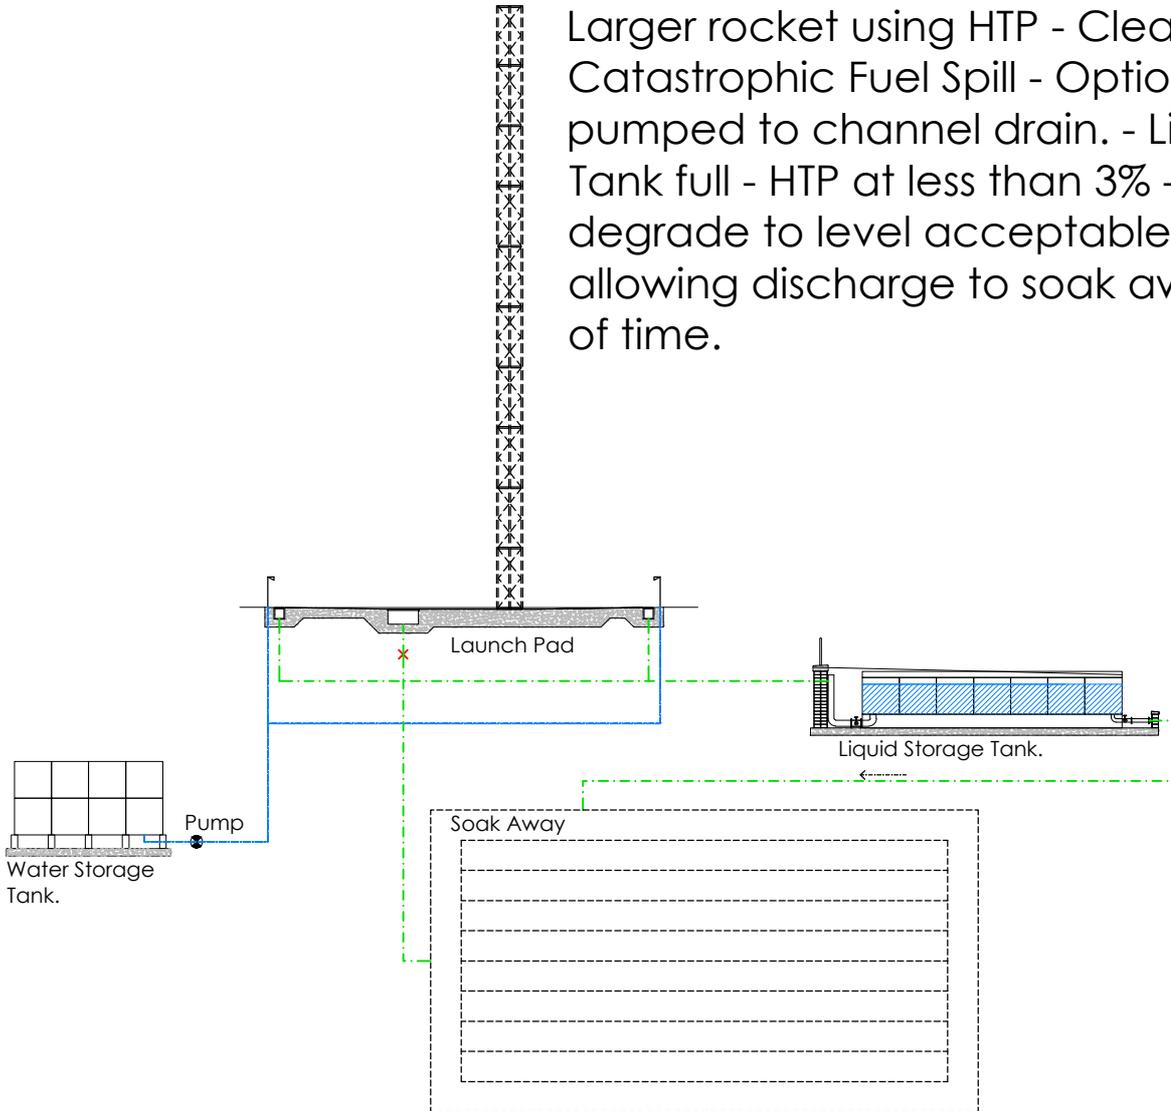

Fraser Architecture LLP
 An Taigh Dearg
 21a Carinish
 Isle of North Uist, HS6 5EJ
 T. 01876 580 315

Title: Pad Containment - Indicative - 7 of 7
 Project: Infrastructure Works for Launching Sounding Rockets
 Client: Comhairle nan Eilean Siar
 Job No: 19_10

Dwg No: (00)34
 Revision: 1
 Date: 12/10/21
 Scale: 1:250 (A4)